




Enclosure Closed

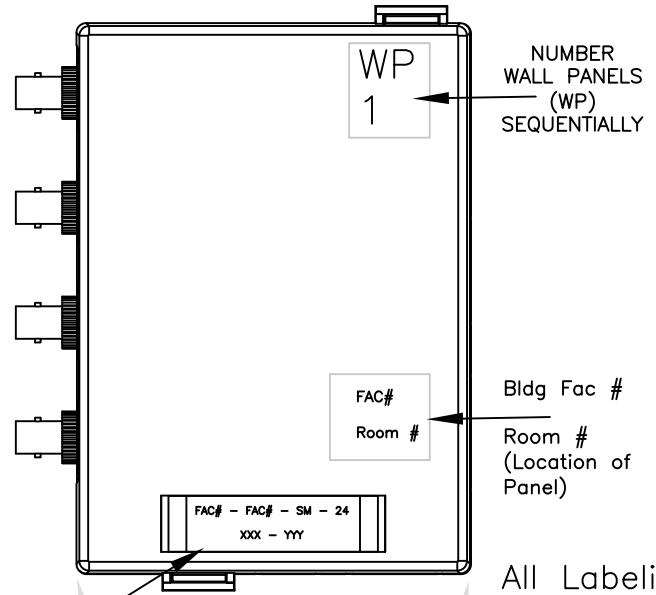


XXX = MDF
YYY = IDF
TYPICAL

Fiber Splice Enclosure

NUMBER WALL PANELS (WP) SEQUENTIALLY

Bldg Fac #
Room #
(Location of Panel)

All Labeling on Fire Alarm Panels & Fiber shall be Red Letters on White Background

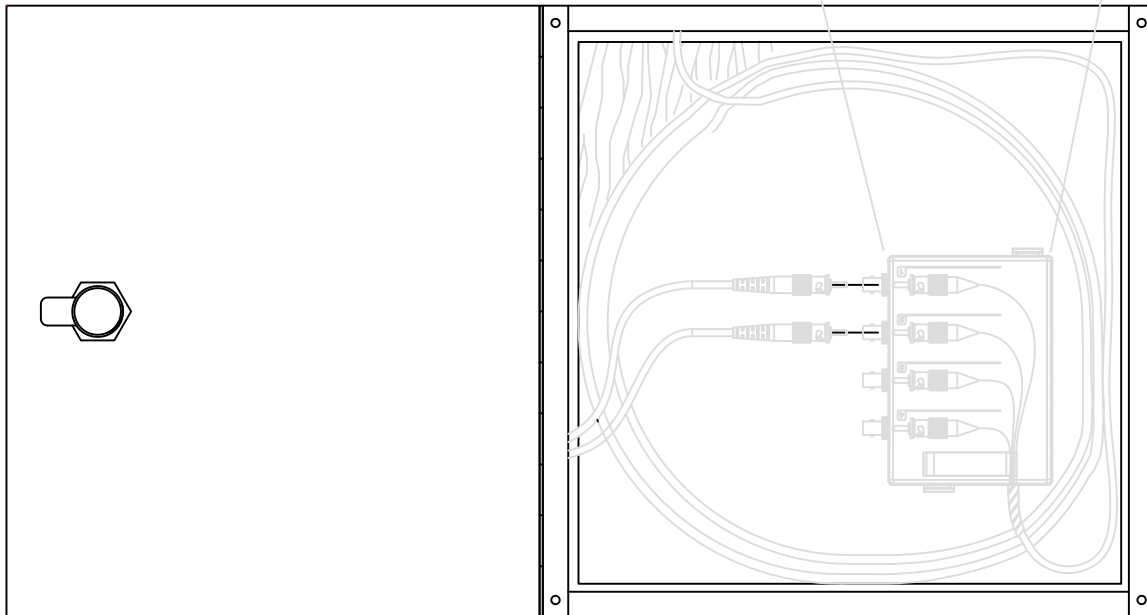

XXX = MDF
YYY = IDF
TYPICAL

FAC# - FAC# - SM - 24
XXX - YYY

Fiber Optic Cable Tag
(attach to cable)

Enclosure Open



UW-IT

FACILITIES PLANNING AND DESIGN

LABELING WALL MOUNTED FA ALARM ENCLOSURE

DRN. BY: J. Templin

CHECK: B. Jones

APPR: L. Zimmerman

DATE: 6/25/15

REV.: DATE:

REV. BY: J. Templin

SCALE:

SCALE/NTS

CAD NAME:

FA Pnl Label

DWG. NO.:

FE-CI-3