


REV.: 1  
DATE: 12/20/16  
REV. BY: J. Templin

DRN. BY: E. SHINE  
CHECK: D. GAGE  
APPR: J. EVANS  
DATE: 10/14/14

SCALE: (11x17)  
1" = 1'-0"

CAD NAME:  
RK-CI-2B.DWG

DWG. NO.:  
RK-CI-2B.1

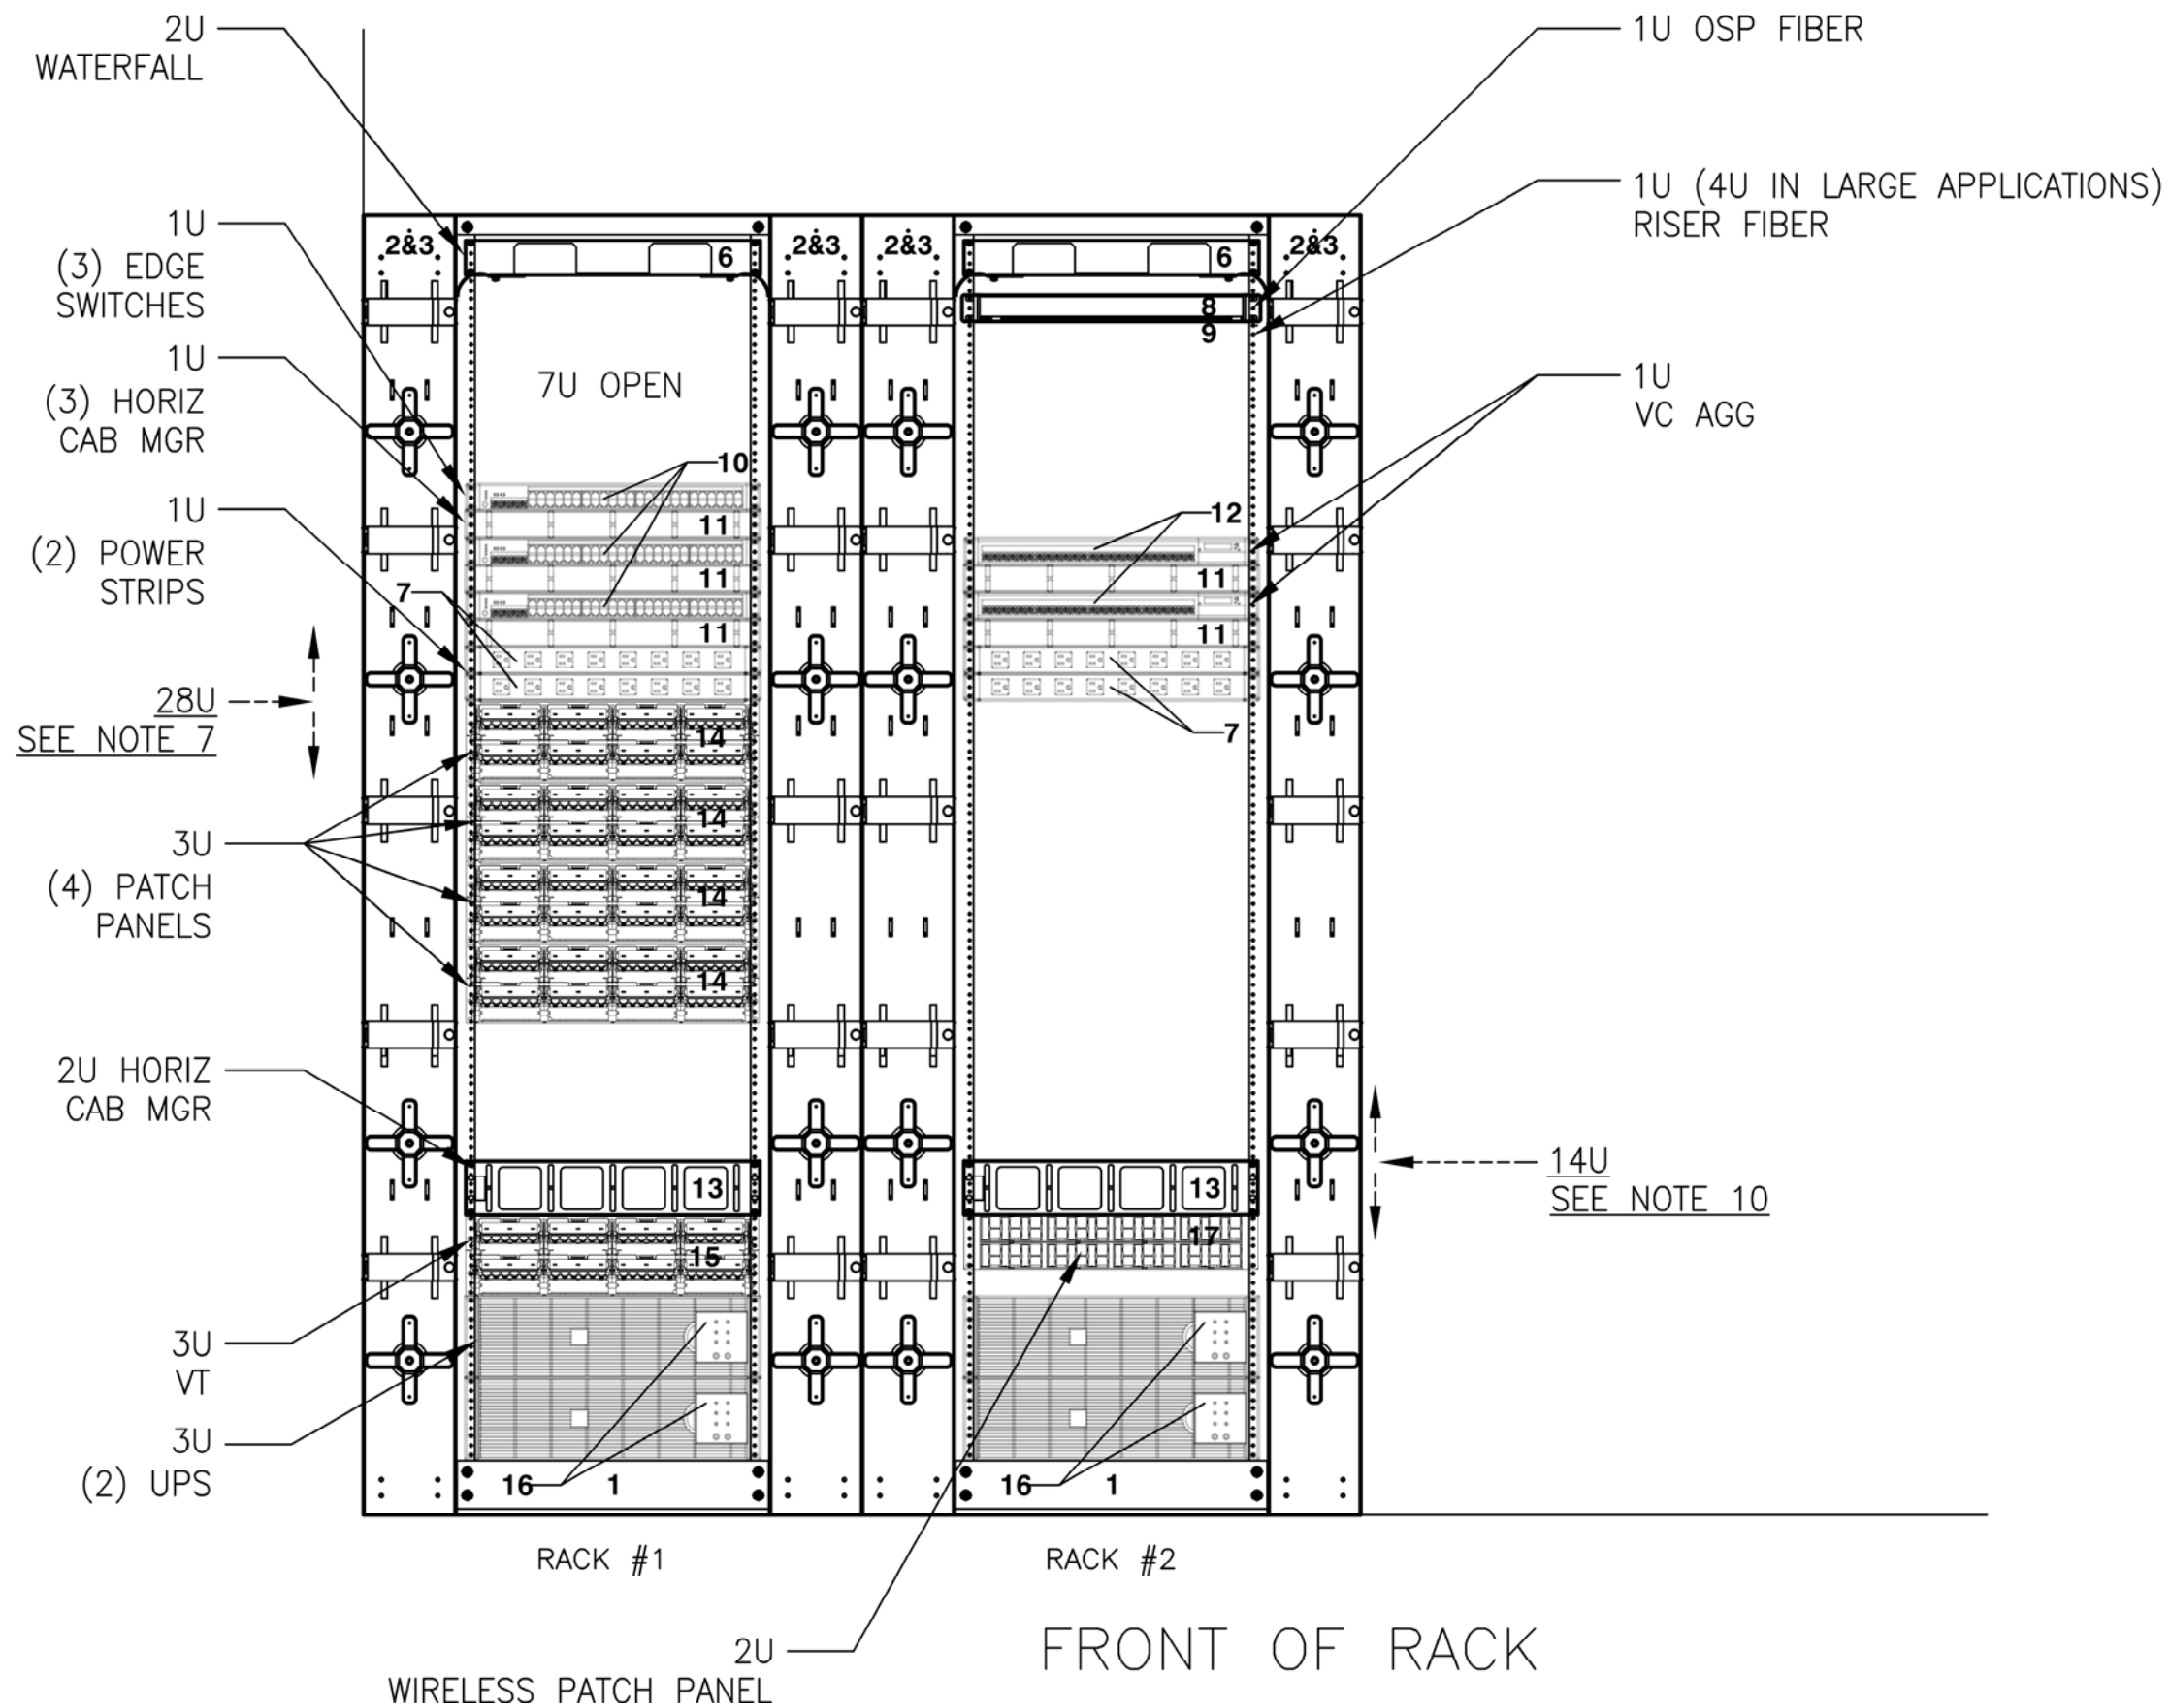

REFER TO SHEET RK-CI-2B.2 FOR POWER & RK-C1-2B.3 FOR ADDITIONAL SPECIFICATIONS, NOTES, AND COMPONENT SCHEDULE

REV.:

DATE:

REV. BY:

DRN. BY: J. Templin

CHECK: A. Dong

APPR: L. Zimmerman

DATE: 12/20/16

SCALE: (11x17)


1" = 1'-0"

CAD NAME:

RK-CI-2B.DWG

DWG. NO.:

RK-CI-2B.2

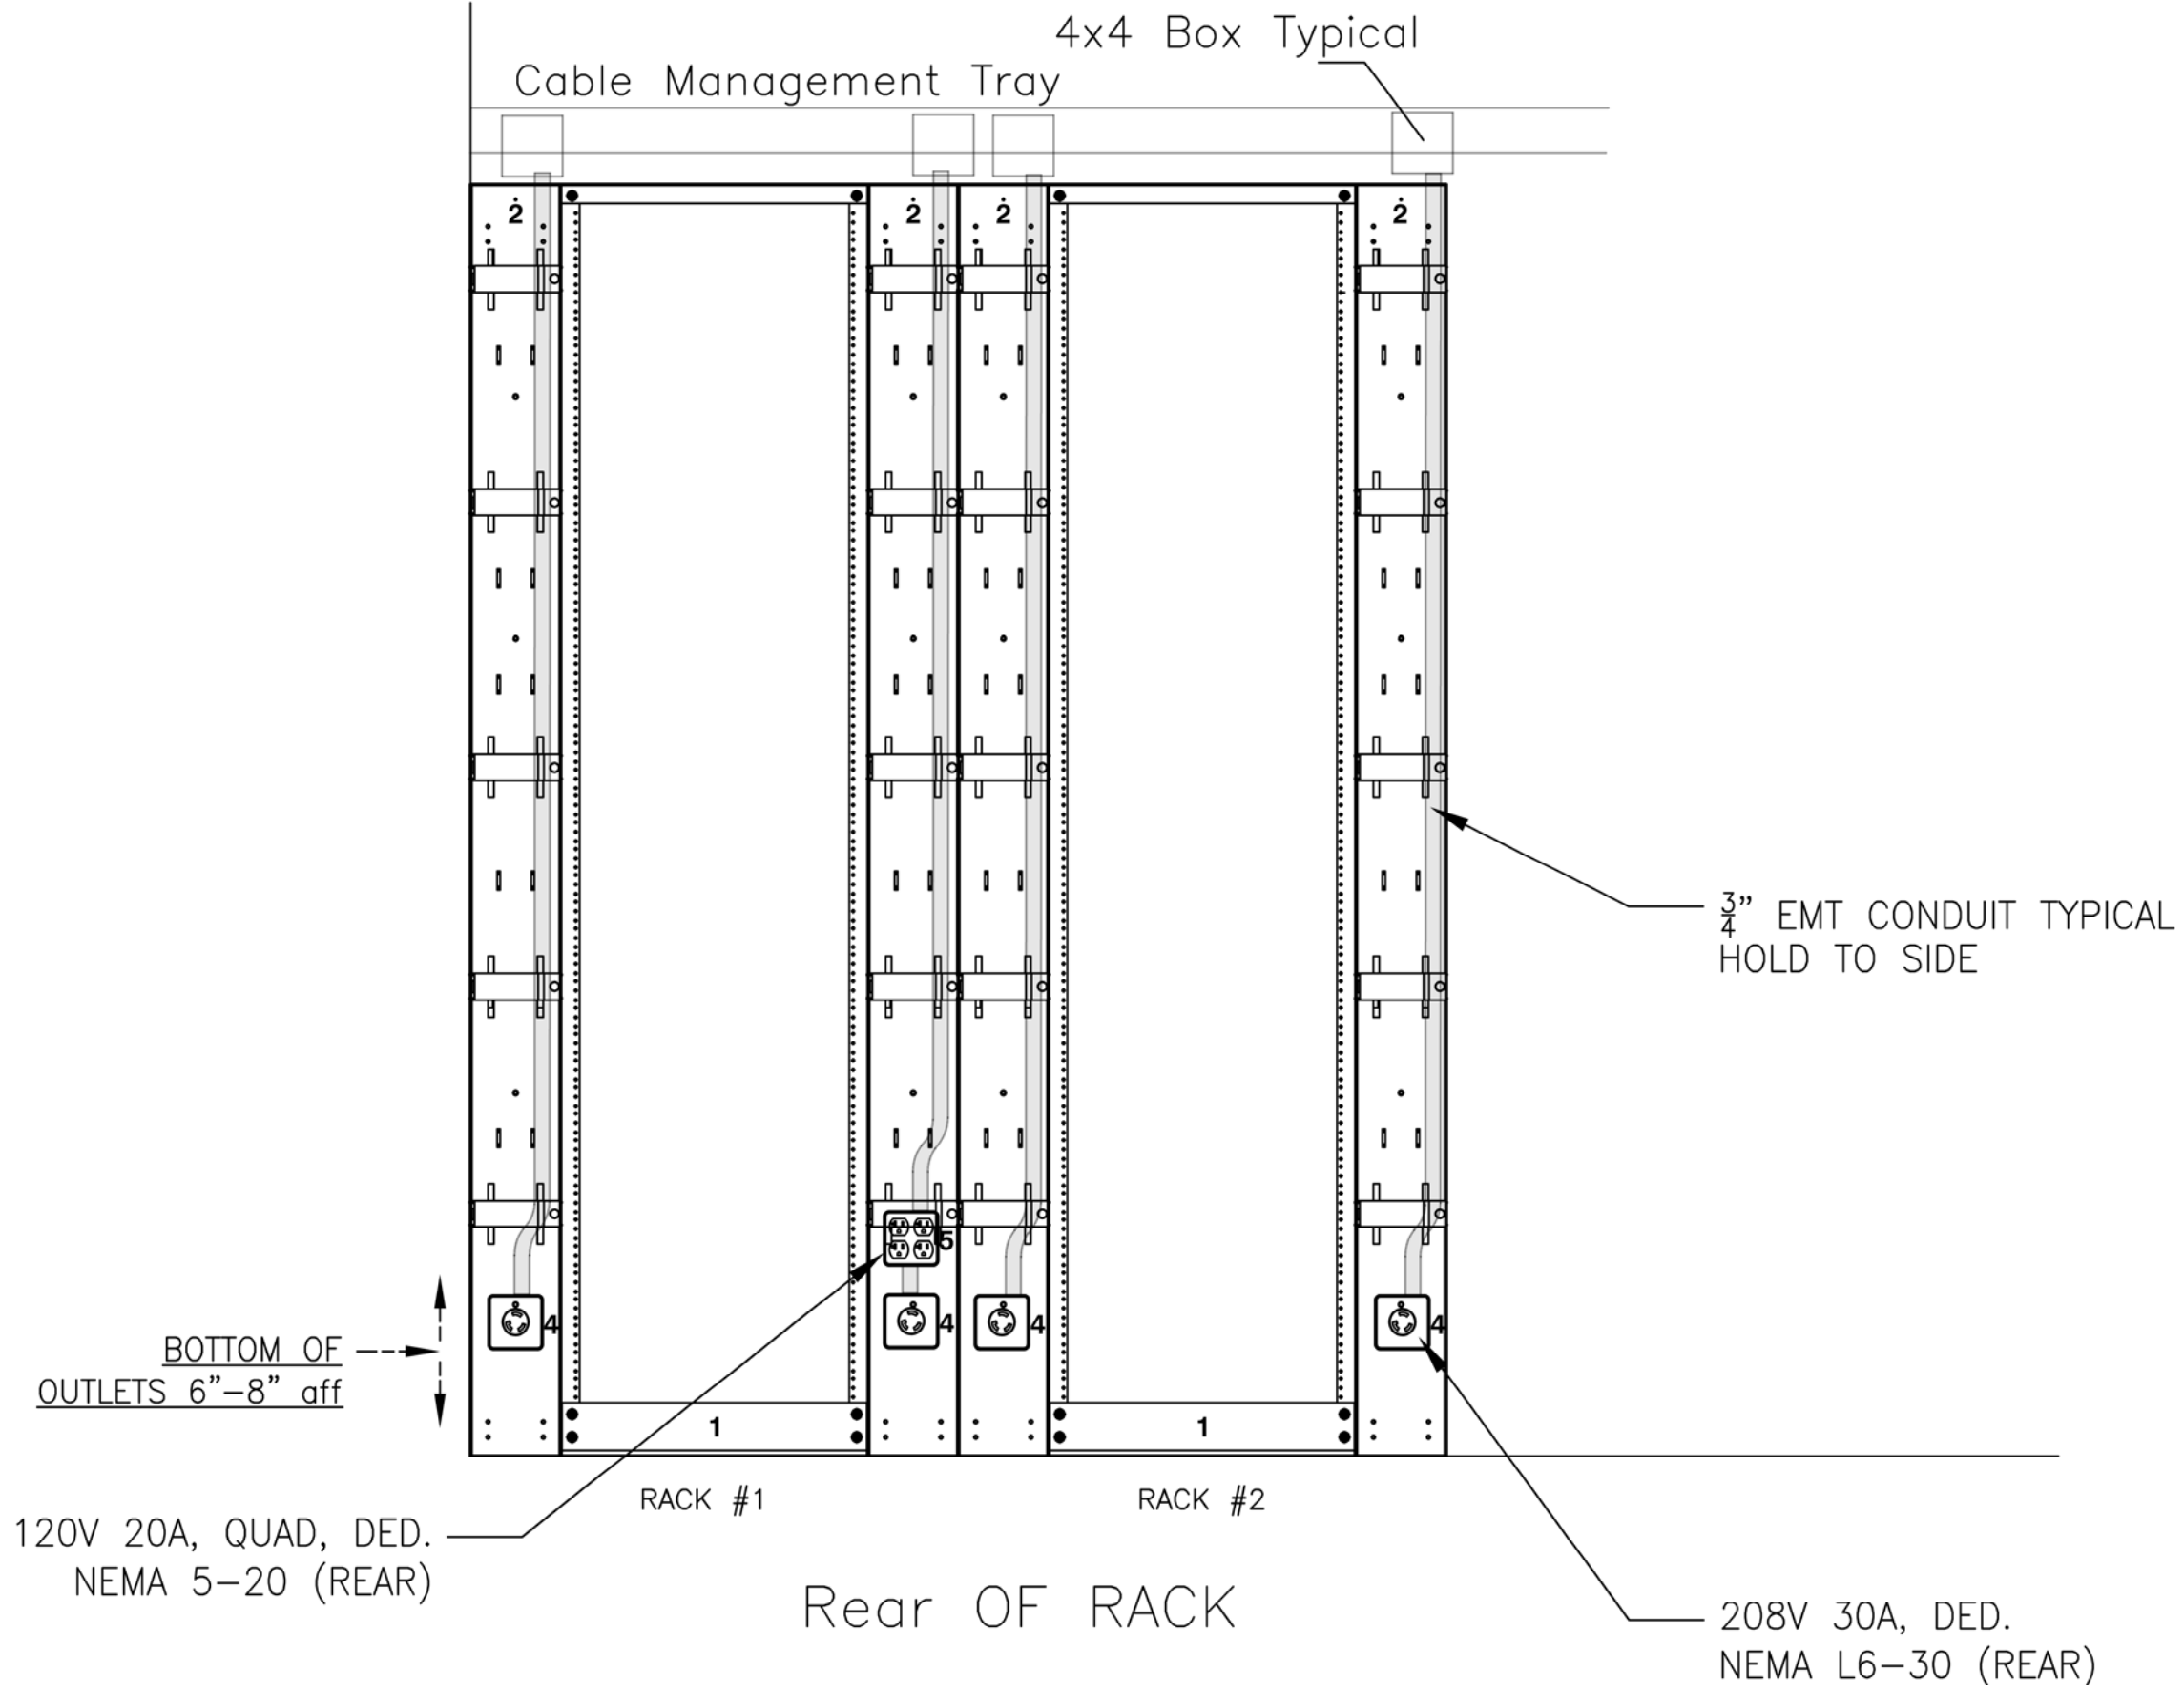

REAR OF RACK SHOWING POWER AND POWER PATHWAYS- SEE RK-C1-2B.3 FOR COMPONENT SCHEDULE

LAYOUT NOTES:

1. UW MEDICINE APPLICATIONS REQUIRE (2) 208V 30A DEDICATED POWER OUTLETS PER RACK AND (1) QUAD DEDICATED 120V 20A POWER OUTLET.
2. IF EMERGENCY POWER IS AVAILABLE, (1) 208V 30A DED. OUTLET SHALL BE ON EMERGENCY POWER, AND (1) 208V 30A DED. OUTLET SHALL REMAIN ON STANDARD POWER PER RACK.
3. POWER OUTLETS ARE MOUNTED REAR-FACING IN THE BACK OF THE VERTICAL CABLE MANAGEMENT UNITS, 8" AFF.
4. POWER STRIPS TO BE INSTALLED REAR-FACING.
5. (2) VERTICAL WIRE MANAGERS PER RACK RECOMMENDED. FINAL DESIGN BASED UPON CABLE DENSITY AND SPACE AVAILABILITY.
6. RACKS TO BE TIED TO GROUND BUS BAR.
7. PATCH PANEL INSTALL BEGINS AT 28U FROM RACK BOTTOM AND EXPANDS DOWN. EDGE SWITCH AND ASSOCIATED CABLE MANAGEMENT BEGINS AT 28U AND EXTENDS UP
8. REFER TO CABLE PATH GUIDE FOR CABLE PATH INSTALLATION REQUIREMENTS. CABLE ROUTING TO BE SPLIT AT CENTER.
9. FINAL RACK LAYOUT, PRODUCTS, AND PROJECT SPECIFICATIONS TO BE CONFIRMED AND APPROVED BY OWNER.
10. TOP OF HORIZONTAL CABLE MANAGER AT 14U FROM BOTTOM OF THE RACK.

RACK COMPONENTS – SCHEDULE B

LAYOUT NUMBER	COMPONENT	REQUIRED PRODUCT	RACK HEIGHT (PER UNIT)
1	RACK	Cooper B-Line SB556084XUFB	84" – 45U
2	VERT. CABLE MGMT.	Corning CDF-IBU-7-6	6"W x 84"H
3	CABLE MGMT. HUB	Corning CDF-HUB-05	N/A
4	208V NEMA L6-30	NEMA L6-30 Receptacle, Dedicated	N/A, REAR MOUNT
5	120V NEMA 5-20	NEMA 5-20 Quad Receptacle, Dedicated	N/A, REAR MOUNT
6	WATERFALL	Chatsworth 12183-719	2U
7	POWER STRIP	Provided by UW-IT, RESERVE SPACE	1U
8	OSP FIBER (96 STRAND)	Corning Pretium EDGE FX EDGE-01U-FP with EDGE-CS12-AE-P00RJ splice cassettes and EDGE-CDF-RJ12-BKT strain relief bracket	1U
9	RISER FIBER	Corning Pretium EDGE FX EDGE-01U-FP with EDGE-CS12-AE-P00RJ splice cassettes and EDGE-CDF-RJ12-BKT strain relief bracket	1U
10	EDGE SWITCH	Provided by UW-IT, RESERVE SPACE	1U
11	HORIZ. CABLE MGMT.	Provided by UW-IT, RESERVE SPACE	1U
12	VC AGG SWITCH	Provided by UW-IT, RESERVE SPACE	1U
13	HORIZ. CABLE MGMT. 2	Hubbell HC219ME3N	2U
14	PATCH PANEL	Commscope Systimax PM-PS-48	3U
15	VOICE TRANSITION	Commscope Systimax PM-PS-48	3U
16	UPS	Provided by UW-IT, RESERVE SPACE	3U
17	WIRELESS	Commscope Systimax M2000-48	2U